



PRESCOTT FIRE DEPARTMENT

1700 Iron Springs Road

Prescott, AZ 86305

928-777-1760 FAX 928-776-1890 TDD 928-778-5680

Fire Department Emergency Access

Posts shall be mounted on the outside edge of the Fire Lane for either option.

Option 1

A 4-inch by 6-ft Steel post buried at 3-ft below grade incased in concrete to provide stability when chain is attached. Minimum amount of concrete shall be a 94-pound sack of pre-mixed concrete. An I bolt will be attached to provide a location to attach the chain. The bolt shall be mounted 3 inches below the top of the post. Post shall be filled with concrete and domed at the top.

Option 2


A 4-inch by 6-ft Pressure treated wood post buried 3-ft below grade incased in concrete to provide stability when chain is attached. Minimum amount of concrete shall be a 94-pound sack of pre- mixed concrete. An I bolt will be attached to provide the location to attach the chain, 3 inches below the top of the post. The I bolt must go completely through the post. A flat washer on both sides the I bolts and a nut on the end.

Chain shall be 16-gauge galvanized steel with 5/8 inch links or larger.

Sign shall be 12 X 18. Thickness of sign shall be .080. Sign shall be made of Aluminum. Sign face shall have a white reflective background with a red legend.

Example: 3M Scotchlite sign face R732 or equivalent with red screen printed letters.

Hang the access sign in the middle of chain. The sign shall be the reflective type. Letters shall be 2 inches high with 5/8" stroke. Letters shall be red on a white background.

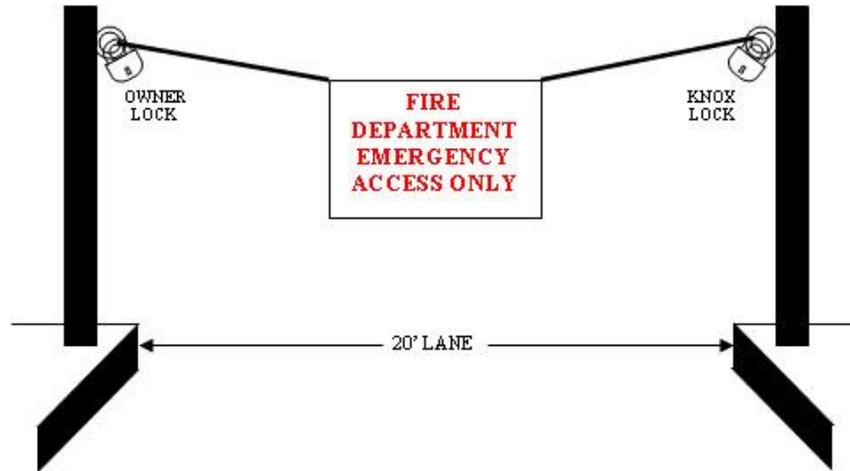

Maintenance. The person(s) in possession of the premises on and into which a fire apparatus access roadway is required shall have sole responsible for the maintenance of such roadways and all required signs. No owner, manager or other persons(s) in charge of the premises served by the required fire apparatus access roadway shall abandoned or close the fire apparatus roadway or any part thereof without written permission of the fire chief.